


INSTALLATION INSTRUCTIONS

1. ENSURE ELECTRICAL SERVICES ARE ISOLATED PRIOR TO ANY WORKS BEING UNDERTAKEN.
2. REMOVE ELECTRICAL FACE PLATE.
3. ENSURE THE APERTURE IS CLEAN AND FREE OF DEBRIS AND LOOSE CEMENT. REMOVE ALL DUST FROM SURFACES REQUIRING INSTALLATION.
4. SELECT THE RYANFIRE POWERPAD TO FIT WITHIN THE METAL FLUSH BOX
5. APPLY RYANFIRE MASTIC TO THE BACK WALL OF THE FLUSH BOX AND FIX THE POWERPAD IN PLACE.
6. FILL ALL GAPS BETWEEN THE PLASTERBOARD OPENING AND THE FLUSH BOX WITH RYANFIRE MASTIC
7. REMOVE EXCESS MASTIC USING A DAMP CLOTH.
8. REFIT ELECTRICAL FACE PLATE.

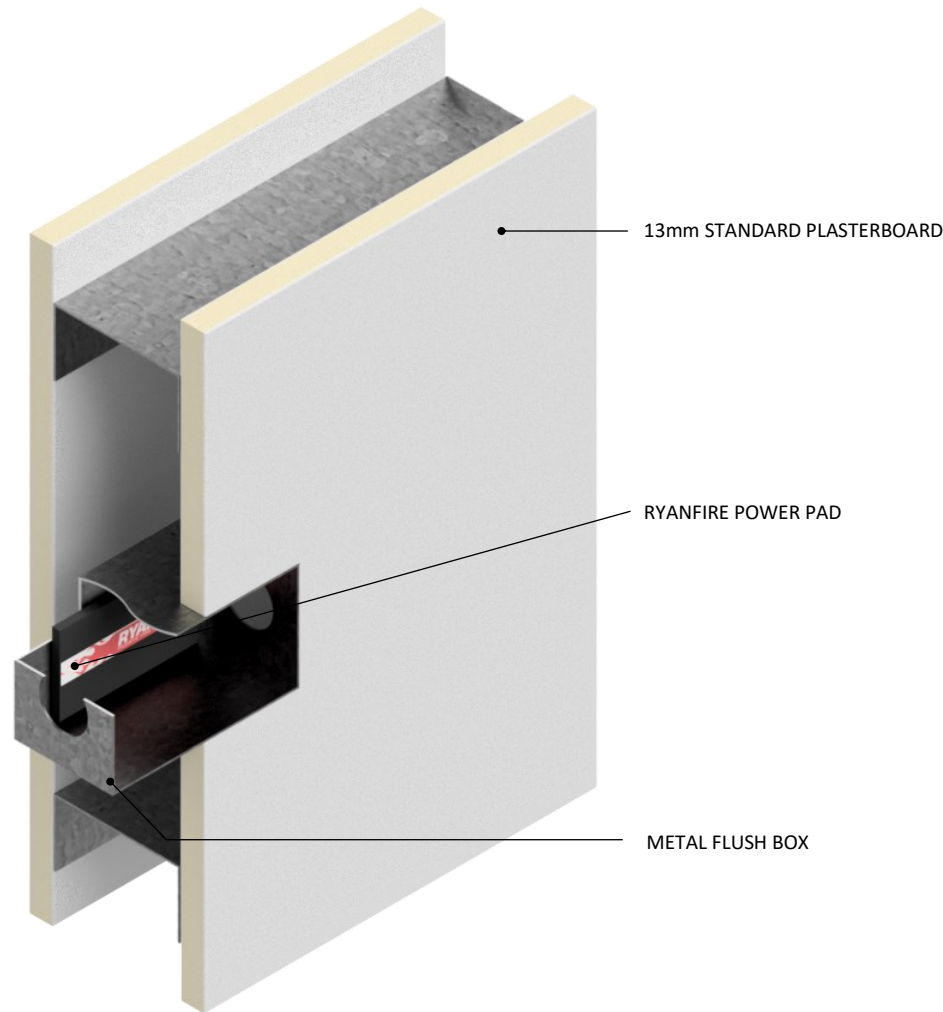

Products:	RYANFIRE POWER PAD RYANFIRE MASTIC
Approval:	AS 1530.4/AS 4072.1
BK:	83
Ref:	PF 20040
ID:	C
Scenario:	Single gang metal flush box
Penetrations:	95mmx55mmx50mm Electrical socket metal flush box
Construction:	90mm Standard plasterboard / Masonry wall 13mm Standard plasterboard
Fire Integrity:	30 minutes
Fire Insulation:	30 minutes

Web based drawings are for example only. Fire performance of any system is dependant on, but not limited to size of opening, substrate, if penetrations are passing through, type, size and number. Please refer to Ryanfire technical department for detailed and specific fire performance information.



Client

Job Title

Drawing Title
**Ryanfire Power Pad to flush box
90mm standard plasterboard wall**

Scale	Date
NTS	July 2024
Sheet Size	Drawn By
A3	
Drawing Number	Rev
V37.4	2.0

Please note:
Ryanfire Products owns and has copyright in these drawings. They are to be used only for the purpose for which they were intended and supplied and are not to be sold, transferred or made available for use by a third party.

Any misuse of these drawings will result in legal proceedings.

All errors and omissions excepted - the Information contained within this drawing is believed to be correct on the date of publication, and is based upon tested and certified solutions. The policy of **RyanFire Products** is one of constant improvement. Installers must therefore ensure that they are following the latest published drawings, test evidence and instructions. Whilst **RyanFire Products** will endeavour to keep its publications up to date, the accuracy of the information contained within this drawing may be affected by pertinent changes in the law or regulatory requirements and alterations or amendments to the specification of the **manufactured** products. Terms and conditions of sale apply.

RYANFIRE Technical Support: info@ryanfire.co.nz - Tel 09 443 0362